



Compact size and well known for its proven reliability, the A-Series utilizes the hydraulic magnetic principle which provides precise operation and performance even when exposed to extremely hot and/or cold application environments. When aesthetics demand a clean contemporary and functional design, the visi-rocker two-color actuator can be specified. A rockerguard and push-to-reset bezel help prevent inadvertent actuation. A specially constructed version is now available for applications requiring CE markings. The A-series is used in many telecommunications and marine applications.

1-6 poles (handle), 1-3 poles (rocker). 0.02 - 50 amps, up to 277 VAC or 80 VDC, with a choice of time delays, terminals and actuator colors.

Agency Certifications

UL Recognized

UL Standard 1077



Component Recognition Program as Protectors, Supplementary (Guide QVNU2, File E75596)

UL Standard 508



Switches, Industrial Control (Guide NRNT2, File E148683)

UL Standard 1500



Protectors, Supplementary for Marine Electrical & Fuel Systems (Guide PEQZ2, File E75596) Ignition Protection

UL Listed

UL Standard 489A



Communications Equipment (Guide DITT, File E189195)

CSA Certified



Component Supplementary Protector under Class 3215 30, File 047848 0 000
CSA Standard C22.2 No. 235

VDE Certified



EN60934, VDE 0642 under File No. 10537

Electrical

Table A: Lists UL Recognized & CSA Certified configurations and performance capabilities as a Component Supplementary Protector.

A-SERIES TABLE A: COMPONENT SUPPLEMENTARY PROTECTOR							
CIRCUIT CONFIGURATION	VOLTAGE			CURRENT RATING		INTERRUPTING CAPACITY(AMPS)	
	MAX RATING	FREQUENCY	PHASE	FULL LOAD AMPS	GENERAL PURPOSE AMPS	UL / CSA	
						WITH BACKUP FUSE	WITHOUT BACKUP FUSE
SERIES	65	DC	---	31 - 50	---	---	3000
	80	DC	---	0.02 - 30	---	---	3000
	80	DC	---	---	31 - 50	---	1500
	125/250	50 / 60	1 ³	0.02 - 30	---	---	3000
	125/250	50 / 60	1 ³	31 - 50	---	---	2000
	250	50 / 60	1	31 - 50	---	2000 ¹	---
	250	50 / 60	1	---	31 - 50	2000 ¹	---
	250	50 / 60	3	0.02 - 20	---	5000 ¹	---
	250	50 / 60	3	21 - 30	---	2000 ¹ 5000 ²	---
	277	50 / 60	1	0.02 - 30	---	5000 ¹	---
DUAL COIL	80	DC	---	0.02 - 30	---	---	3000
	250	50 / 60	1 & 3	0.02 - 20	---	5000 ¹	---
	250	50 / 60	1 & 3	21 - 30	---	2000 ¹ 5000 ²	---
	277	50 / 60	1	0.02 - 30	---	5000 ¹	---
SHUNT	80	DC	---	0.02 - 30	---	---	3000
	250	50 / 60	1 & 3	0.02 - 20	---	5000 ¹	---
	250	50 / 60	1 & 3	21 - 30	---	2000 ¹ 5000 ²	---
	277	50 / 60	1	0.02 - 30	---	5000 ¹	---
RELAY	80	DC	---	0.02 - 30	---	---	3000
	250	50 / 60	1 & 3	0.02 - 20	---	5000 ¹	---
	250	50 / 60	1 & 3	21 - 30	---	2000 ¹ 5000 ²	---
	277	50 / 60	1	0.02 - 30	---	5000 ¹	---
SWITCH ONLY	65	DC	---	0.02 - 50	---	---	---
	80	DC	---	0.02 - 30	---	---	---
	250	50 / 60	1	31 - 50	---	---	---
	250	50 / 60	1	---	31 - 50	---	---
	250	50 / 60	3	0.02 - 50	---	---	---
	277	50 / 60	1	0.02 - 30	31 - 50	---	---

Notes for Table A:

- 1 Requires branch circuit backup with a UL LISTED Type K5 or RK5 fuse (15A minimum) at no more than 4 times the rating of the protector.
- 2 Same as note 1, except that backup fuse is limited to 80 A maximum.
- 3 2 pole protector required (with one pole per power line) for: 250/125 VAC, 125/250 VAC and 208Y/120 VAC Power Systems. 1 pole protector required for : 125 VAC, 1Ø Power System.

Electrical

Table B: Lists UL Recognized, CSA, VDE & TUV Certified configurations & performance capabilities as a Component Supplementary Protector.

A-SERIES TABLE B: COMPONENT SUPPLEMENTARY PROTECTOR												
CIRCUIT CONFIGURATION	VOLTAGE			CURRENT RATING		INTERRUPTING CAPACITY (AMPS)						VDE CONSTRUCTION NOTES
	MAX RATING	FREQUENCY	PHASE	FULL LOAD AMPS	GENERAL PURPOSE AMPS 1	UL / CSA		VDE		TUV		
						WITH BACKUP FUSE	WITHOUT BACKUP FUSE	(Inc) WITH BACKUP FUSE	(Icn) WITHOUT BACKUP FUSE	(Inc) WITH BACKUP FUSE	(Icn) WITHOUT BACKUP FUSE	
SERIES	80	DC	---	0.10 - 30	---	---	3000	3000	1500	3000	1500	Handle Version 1 Pole Only
	80	DC	---	31 - 50	31 - 50	---	1500	3000	1500	3000	1500	Handle Version 1 Pole Only
	80	DC	---	0.10 - 30	---	---	3000	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	80	DC	---	31 - 32	31 - 32	---	1500	3000	1500	3000	1500	Rocker Version 2 Pole Only
	80	DC	---	31 - 50	31 - 50	---	1500	3000	1500	3000	1500	Rocker Version 1 Pole Only
	250	50/60	1 & 3	0.10 - 20	---	5000 ²	3000	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1 & 3	21 - 30	---	2000 ² 5000 ³	---	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1	0.10 - 30	---	---	2000	3000	1500	5000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1	31 - 50	---	---	2000	---	---	5000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1	31 - 32	---	2000 ²	---	3000	1500	5000	1500	Rocker Version 2 Poles Only
DUAL COIL	80	DC	---	0.10 - 30	---	---	3000	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1 & 3	0.10 - 20	---	5000 ²	---	3000	1500	3000	1500	
	250	50/60	1 & 3	21 - 30	---	2000 ² 5000 ³	---	3000	1500	3000	1500	
	250	50/60	1	31 - 50	31 - 50	---	2000	---	---	5000	1500	Rocker Version 1 - 3 Poles
SHUNT	80	DC	---	0.10 - 30	---	---	3000	3000	1500	3000	1500	Handle Version 1 Pole Only
	80	DC	---	0.10 - 30	---	---	3000	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1 & 3	0.10 - 20	---	5000 ²	---	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1 & 3	21 - 30	---	2000 ² 5000 ³	---	3000	1500	3000	1500	Rocker Version 1 - 3 Poles
	250	50/60	1	31 - 50	31 - 50	---	2000	---	---	5000	1500	Rocler Version 1 - 3 Poles

Notes for Table B:

- 1 General Purpose Ratings for UL/CSA Only.
- 2 Requires branch circuit backup with a UL LISTED Type K5 or RK5 fuse (15A minimum) at no more than 4 times the rating of the protector.
- 3 Same as note 2, except that backup fuse is limited to 80 A maximum.

Table C: Lists UL Recognized, CSA Certified configurations and performance capabilities as Protectors, Supplementary for Marine Electrical and Fuel Systems (Guide PEQ22, File E75596). Ignition Protected per UL 1500. UL Classified Small Craft Electrical Devices, Marine in accordance with ISO 8846 (Guide UZMK, File MQ1515) as Marine Supplementary Protectors.

A-SERIES TABLE C: UL1500 (MARINE IGNITION PROTECTED)					
CIRCUIT CONFIGURATION	VOLTAGE			CURRENT RATING	INTERRUPTING CAPACITY (AMPS)
	MAX RATING	FREQ.	PHASE	FULL LOAD AMPS	WITHOUT BACKUP FUSE
SERIES	14 ¹	DC	---	0.02 - 50	5000
	65	DC	---	0.02 - 50	3000
	125 / 250	50 / 60	1 ²	0.02 - 50	1500
	250	50 / 60	1	0.02 - 30	1000

Notes for Table C:

- 1 Available with special catalog number only (consult factory).
- 2 2 pole protector required (with one pole per power line) for: 250/125 VAC, 125/250 VAC and 208Y/120 VAC Power Systems. 1 pole protector required for : 125 VAC, 1Ø Power System.


Table D: Lists UL Listed configurations and performance capabilities as Circuit Breakers for use in Communications Equipment (Guide DITT, File E189195), under UL489A.

A-SERIES TABLE D: UL489A (COMMUNICATIONS EQUIPMENT)				
CIRCUIT CONFIGURATION	VOLTAGE		CURRENT RATING	INTERRUPTING CAPACITY (AMPS)
	MAX RATING	FREQUENCY	UL GENERAL PURPOSE AMPS	WITHOUT BACKUP FUSE
SERIES	80	DC	.10 - 50	5000



Electrical

Maximum Voltage	277VAC 50/60 Hz, 80VDC
Current Ratings	Standard current coils: 0.100, 0.250, 0.500, 0.750, 1.00, 2.50, 5.00, 7.50, 10.0, 15.0, 20.0, 25.0, 30.0, 35.0, 40.0, 50.0. Other ratings available - consult ordering scheme.
Standard Voltage Coils	DC-6V, 12V; AC-120V, Other ratings available, consult ordering scheme.
Auxiliary Switch Rating	SPDT; 10.1 A - 250VAC, 1.0 A-65VDC/0.5 A - 80 VDC, 0.1A - 125VAC (with gold contacts).
Insulation Resistance	Minimum: 100 Megohms at 500 VDC
Dielectric Strength	UL, CSA - 1500V 60 Hz for one minute between all electrically isolated terminals. A-Series rocker circuit breakers comply with the 8mm spacing & 3750V dielectric requirements from hazardous voltage to operator accessible surfaces per EN 60950 and VDE 0805.
Resistance, Impedance	Values from Line to Load Terminal - based on Series Trip Circuit Breaker.

RESISTANCE, IMPEDANCE VALUES
from Line to Load Terminals
(Values Based on Series Trip Circuit Breaker)

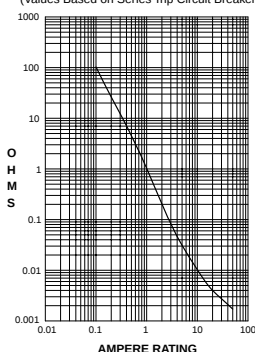

CURRENT (AMPS)	TOLERANCE (%)
0.10 - 5.0	± 15%
5.1 - 20.0	± 25%
20.1 - 50.0	± 35%

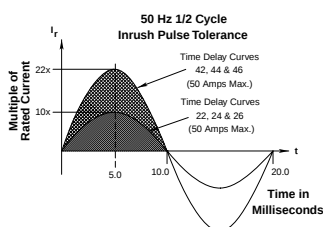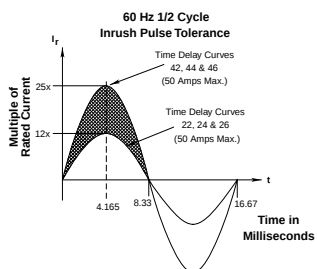

Mechanical

Endurance	10,000 ON-OFF operations @ 6 per minute; with rated Current & Voltage.
Trip Free	All A-Series Circuit Breakers will trip on overload, even when the actuator is forcibly held in the ON position.
Trip Indication	The operating actuator moves positively to the OFF position when an overload causes the circuit breaker to trip. When mid-trip handle is specified, the handle moves to the mid position on electrical trip of the circuit breaker. When mid-trip handle with alarm switch is specified, the handle moves to the mid position & the alarm switch actuates when the circuit breaker is electrically tripped.

Physical

Number of Poles	1 - 6 Poles (handle) and 1-3 poles (rocker) at 30 Amps or less. 1 and 2 poles at 31 Amps thru 50 Amps.
Internal Circuit Configurations	Series, (with or without auxiliary switch), Shunt and Relay with current or voltage trip coils, Dual Coil, Switch Only with or without auxiliary switch.
Weight	Approximately 65 grams/pole. (Approximately 2.32 ounces/pole)
Standard Colors	Housing - Black; Actuator- See Ordering Scheme.

Environmental

Designed and tested in accordance with requirements of specification MIL-PRF-55629 & MIL-STD-202 as follows:

Shock	Withstands 100 Gs, 6ms, sawtooth while carrying rated current per Method 213, Test Condition "I". Instantaneous and ultra-short curves tested @ 90% of rated current.
Vibration	Withstands 0.060" excursion from 10-55 Hz, and 10 Gs 55-500 Hz, at rated current per Method 204C, Test Condition A. Instantaneous and ultrashort curves tested at 90% of rated current.
Moisture Resistance	Method 106D; ten 24-hour cycles @ + 25°C to +65°C, 80-98% RH.56 days @ +85°C, 85% RH.
Salt Spray	Method 101, Condition A (90-95% RH @ 5% NaCl Solution, 96 hrs).
Thermal Shock	Method 107D, Condition A (Five cycles @ -55°C to +25°C to +85°C to +25°C).
Operating Temperature	-40° C to +85° C

A	A	3	B	0	10	450	1	B	1	C
1 Series	2 Actuator	3 Poles	4 Circuit	5 Aux/Alarm Switch	6 Frequency & Delay	7 Current Rating	8 Terminal	9 Actuator Color	10 Mounting/Barriers	11 Agency Approval

1 SERIES
A
2 ACTUATOR¹

A Handle, one per pole
B Handle, one per multipole unit
S Mid-Trip Handle, one per pole
T Mid-Trip Handle, one per pole & Alarm Switch

3 POLES

1	One	3	Three	5	Five
2	Two	4	Four	6	Six

4 CIRCUIT

A²	Switch Only (No Coil)	F³	Relay Trip (Current)
B	Series Trip (Current)	G³	Relay Trip (Voltage)
C	Series Trip (Voltage)	H^{3,4}	Dual Coil with Shunt Trip Voltage Coil
D³	Shunt Trip (Current)	K^{3,4}	Dual Coil with Relay Trip Voltage Coil
E³	Shunt Trip (Voltage)		

5 AUXILIARY/ALARM SWITCH⁵

0	w/o Aux Switch	5	S.P.S.T., 0.093 Q.C. Term.(Gold Contacts)
1	S.P.D.T., 0.093 Q.C. Term.	6	S.P.S.T., 0.139 Solder Lug
2	S.P.D.T., 0.110 Q.C. Term.	7	S.P.S.T., 0.110 Q.C. Term.(Gold Contacts)
3	S.P.D.T., 0.139 Solder Lug	8	S.P.S.T., 0.187 Q.C. Term.
4	S.P.D.T., 0.110 Q.C. Term.(Gold Contacts)	9	S.P.D.T., 0.187 Q.C. Term.

6 FREQUENCY & DELAY

03	DC 50/60Hz, Switch Only	30	DC, 50/60Hz Instantaneous
10⁶	DC Instantaneous	31	DC, 50/60Hz Ultra Short
11	DC Ultra Short	32	DC, 50/60Hz Short
12	DC Short	34	DC, 50/60Hz Medium
14	DC Medium	36	DC, 50/60Hz Long
16	DC Long	42⁷	50/60Hz Short, Hi-Inrush
20⁶	50/60Hz Instantaneous	44⁷	50/60Hz Medium, Hi-Inrush
21	50/60Hz Ultra Short	46⁷	50/60Hz Long, Hi-Inrush
22	50/60Hz Short	52⁷	DC, Short, Hi-Inrush
24	50/60Hz Medium	54⁷	DC, Medium, Hi-Inrush
26	50/60Hz Long	56⁷	DC, Long, Hi-Inrush

7 CURRENT RATING (AMPERES)

020	0.020	225	0.250	420	2.000	611	11.000
025	0.025	230	0.300	522	2.250	711	11.500
030	0.030	235	0.350	527	2.750	612	12.000
035	0.035	240	0.400	430	3.000	712	12.500
040	0.040	245	0.450	435	3.500	613	13.000
045	0.045	250	0.500	440	4.000	614	14.000
050	0.050	255	0.550	445	4.500	615	15.000
055	0.055	260	0.600	450	5.000	616	16.000
060	0.060	265	0.650	455	5.500	617	17.000
065	0.065	270	0.700	460	6.000	618	18.000
070	0.070	275	0.750	465	6.500	620	20.000
075	0.075	280	0.800	470	7.000	622	22.000
080	0.080	285	0.850	475	7.500	624	24.000
085	0.085	290	0.900	480	8.000	625	25.000
090	0.090	295	0.950	485	8.500	630	30.000
095	0.095	410	1.000	490	9.000	635⁸	35.000
210	0.100	512	1.250	495	9.500	640⁸	40.000
215	0.150	415	1.500	610	10.000	645⁸	45.000
220	0.200	517	1.750	710	10.500	650⁸	50.000

OR VOLTAGE COIL (NOMINAL RATED VOLTAGE)⁶

A06	6 DC	A32	32 DC	J12	12 AC	J65	65 AC
A12	12 DC	A48	48 DC	J18	18 AC	K20	120 AC
A18	18 DC	A65	65 DC	J24	24 AC	L40	240 AC
A24	24 DC	J06	6 AC	J48	48 AC		

8 TERMINAL⁹

1¹⁰	Push-On 0.250 Tab (Q.C.)	E¹¹	Screw M4 (Bus Type)
2	Screw 8-32 w/upturned lugs	F	Screw M5 w/upturned lugs and 30° bend
3¹¹	Screw 8-32 (Bus Type)	G	Screw M5 (Bus Type) and 30° bend
4	Screw 10-32 w/upturned lugs	H	Screw M5 (Bus Type)
5¹¹	Screw 10-32 (Bus Type)	L¹²	0.250 Q.C./ Solder Lug
6	Screw 8-32 w/upturned lugs and 30° bend	M¹¹	M6 Threaded Stud
7	Screw 8-32 (Bus Type) and 30° bend	Q	Push-In Stud
8	Screw 10-32 w/upturned lugs and 30° bend	R	Screw M4 w/upturned lugs and 30° bend
9	Screw 10-32 (Bus Type) and 30° bend	T¹¹	Screw M4 (Bus Type) and 30° bend
B	Screw M5 w/upturned lugs	P¹³	Printed Circuit Board Terminals
C	Screw M4 w/upturned lugs	S¹³	Push-On 0.110 Tab (Q.C.)

9 ACTUATOR COLOR & LEGEND

Actuator Color	I-O	ON-OFF	Dual	Legend Color
White	A	B	1	Black
Black	C	D	2	White
Red	F	G	3	White
Green	H	J	4	White
Blue	K	L	5	White
Yellow	M	N	6	Black
Gray	P	Q	7	Black
Orange	R	S	8	Black
Black (short handle) ¹⁴	T	U	9	White

10 MOUNTING/BARRIERS

	MOUNTING STYLE	BARRIERS
	Threaded Inserts, 2 per pole	
1	6-32 x 0.195 inches	no
A	6-32 X 0.195 inches	yes
2	ISO M3 x 5mm	no
B	ISO M3 x 5mm	yes
	Front panel Snap-In, 0.75" wide bezel	
5	without Handleguard	no
6	without Handleguard	yes
	Front panel Snap-In, 0.96" wide bezel	
7	without Handleguard on 1-pole units; .105 " bezel overhang/ side on multipole units	no
8	without Handleguard on 1-pole units; .105 " bezel overhang/side on multipole units	yes

11 AGENCY APPROVAL

C	UL Recognized & CSA Certified
D	VDE Certified, UL Recognized & CSA Certified
E	TUV Certified, UL Recognized & CSA Certified
I	UL Rec. STD 1077, UL Rec. 1500 (ignition protected), & CSA Certified

Notes:

- Actuator Code:
A: Handle tie pin spacer(s) and retainers provided unassembled with multi-pole units.
B: Handle location as viewed from front of breaker:
2 pole - left pole 3 pole - center pole
4 pole - two handles at center poles 5 pole - three handles at center poles
6 pole - four handles at center poles
S: Handle moves to mid-position only upon electrical trip of the breaker. Available with circuit codes B, C, D, E, F, G, H and K.
T: Handle moves to mid-position and alarm switch activates only upon electrical trip of the breaker. Available with circuit codes B & C.
2: Switch Only circuits, rated up to 50 amps and 6 poles, and only available with VDE Certification when tied to a protected pole (Circuit Code B, C, D or H). For .02 to 30 amps, select Current Code 630. For 35 - 50 amps, select Current Code 650.
3: Available with terminal Codes 1, 2 and 3. Current Rating limited to 30 amps maximum.
4: Consult factory for available Dual Coil options, as special catalog number is required. With Shunt construction, Dual Coils will trip instantaneously on line voltage. Dual coils require 30VA minimum power to trip and are rated for intermittent duty only.
5: Auxiliary Switch breakers with Series Trip & Switch Only circuits: ≤ 30A - supplied with standard half shells. 35-50A - supplied with extended boat (B-Style) half shells. On multi-pole breakers, one auxiliary switch is supplied, mounted in the extreme right pole.
6: Separate pole type voltage coils not rated for continuous duty. Available only with delay codes 10 and 20.
7: Available with Circuit Codes B & D only. VDE Certified to 30 amps. UL Recognized and CSA Certified to 50 amps.
8: VDE Certification available with single pole breakers with DC Delay only. UL Recognition and CSA Certification available in one and two pole breakers.
9: Screw Terminals are recommended on ratings greater than 20 amps. Ratings over 30 amps are only available with Terminal Codes 5, 9, G, H, M and Q..
10: Terminal Code 1: VDE Certification up to 25 amps and UL Recognition and CSA Certification up to 30 amps, but not recommended over 20 amps.
11: Terminal Codes 3, 5, E and H (Bus Type) with VDE, are supplied with Lock Washers, and Terminal Code M (M6 Threaded Stud) with VDE is supplied with Lock and Flat Washers. These breakers are only VDE Certified when the washers are used.
12: Terminal Code L: VDE Cert. available up to 12 amps. UL Rec. & CSA Cert. available up to 30 amps.
13: Single pole breakers with Terminal Code P (Printed Circuit Board) are available up to 30 amps with VDE Certification and 50 amps with UL Recognition and CSA Certification, with Circuit Codes A, B and C. Two pole breakers with Terminal Code P (Printed Circuit Board) are available up to 40 amps with UL Recognition and CSA Certification with Circuit Codes A, B and C.
14: Single pole only.

A	A	1	B	0	14	450	1	B	1	M	T
1 Series	2 Actuator	3 Poles	4 Circuit	5 Aux/Alarm Switch	6 Frequency & Delay	7 Current Rating	8 Terminal	9 Actuator Color	10 Mounting/ Barriers	11 Max. Appl. Rating	12 Agency Approval

1 SERIES
A
2 ACTUATOR¹

A Handle, one per pole
S Mid-Trip Handle, one per pole
T Mid-Trip Handle, one per pole & Alarm Switch

3 POLES²

1 One **2** Two **3** Three **4** Four

4 CIRCUIT

B Series Trip (Current)

5 AUXILIARY/ALARM SWITCH²

0 w/o Aux Switch	7 S.P.S.T., 0.110 Q.C.
1 S.P.D.T., 0.093 Q.C. Term.	Term.(Gold Contacts)
2 S.P.D.T., 0.110 Q.C. Term.	8 S.P.S.T., 0.187 Q.C. Term.
3 S.P.D.T., 0.139 Solder Lug	9 S.P.D.T., 0.187 Q.C. Term.

6 FREQUENCY & DELAY

11 DC Ultra Short	52³ DC, Short, Hi-Inrush
12 DC Short	54³ DC, Medium, Hi-Inrush
14 DC Medium	56³ DC, Long, Hi-Inrush
16 DC Long	

7 CURRENT RATING (AMPERES)

210 0.100	415 1.500	710 10.500
215 0.150	517 1.750	611 11.000
220 0.200	420 2.000	711 11.500
225 0.250	522 2.250	612 12.000
230 0.300	527 2.750	712 12.500
235 0.350	430 3.000	613 13.000
240 0.400	435 3.500	614 14.000
245 0.450	440 4.000	615 15.000
250 0.500	445 4.500	616 16.000
255 0.550	450 5.000	617 17.000
260 0.600	455 5.500	618 18.000
265 0.650	460 6.000	620 20.000
270 0.700	465 6.500	622 22.000
275 0.750	470 7.000	624 24.000
280 0.800	475 7.500	625 25.000
285 0.850	480 8.000	630 30.000
290 0.900	485 8.500	635⁴ 35.000
295 0.950	490 9.000	640⁴ 40.000
410 1.000	495 9.500	645⁴ 45.000
512 1.250	610 10.000	650⁴ 50.000

8 TERMINAL⁵

1⁶ Push-On 0.250 Tab (Q.C.)	9 Screw 10-32 (Bus Type) and 30° bend
2 Screw 8-32 w/upturned lugs	B Screw M5 w/upturned lugs
3⁷ Screw 8-32 (Bus Type)	F Screw M5 w/upturned lugs and 30° bend
4 Screw 10-32 w/upturned lugs	G Screw M5 (Bus Type) and 30° bend
5⁷ Screw 10-32 (Bus Type)	H Screw M5 (Bus Type)
6 Screw 8-32 w/upturned lugs and 30° bend	M⁷ M6 Threaded Stud
7 Screw 8-32 (Bus Type) and 30° bend	P⁸ Printed Circuit Board Terminals
8 Screw 10-32 w/upturned lugs and 30° bend	Q Push-In Stud

9 ACTUATOR COLOR

LEGEND		
ON-OFF	Dual	Legend Color
White	B	1 Black
Black	D	2 White
Red	G	3 White
Green	J	4 White
Blue	L	5 White
Yellow	N	6 Black
Gray	Q	7 Black
Orange	S	8 Black
Black (short handle) ⁹	T	9 White

10 MOUNTING/BARRIERS

MOUNTING STYLE	BARRIERS
Threaded Insert, 2 per pole	
1 6-32 x 0.195 inches	no
A 6-32 X 0.195 inches	yes
2 ISO M3 x 5mm	no
B ISO M3 x 5mm	yes
Front panel Snap-In, 0.75" wide bezel	
5 without Handleguard	no
6 without Handleguard	yes
Front panel Snap-In, 0.96" wide bezel	
7 without Handleguard on 1-pole units; .105 " bezel overhang/ side on multipole units	no
8 without Handleguard on 1-pole units; .105 " bezel overhang/ side on multipole units	yes

11 MAXIMUM APPLICATION RATING

M 80 DC

12 AGENCY APPROVAL

T UL489A LISTED
K UL489A LISTED, VDE CERTIFIED

Notes:

- Actuator Code:
A: Handle tie pin spacer(s) and retainers provided unassembled with multi-pole units.
S: Handle moves to mid-position only upon electrical trip of the breaker.
T: Handle moves to mid-position and alarm switch activates only upon electrical trip of the breaker.
- On multi-pole breakers, one auxiliary switch is supplied, mounted in the extreme right pole.
- VDE Certified to 30 amps. UL489A Listed to 50 amps.
- VDE Certification available with single pole breakers only. UL489A Listing available with one and two pole breakers.
- Screw Terminals are recommended on ratings greater than 20 amps. Ratings over 30 amps are only available with Terminal Codes 5, 9 G, H, M and Q.
- Terminal Code 1 (Push-On) available up to 25 amps with VDE Certification and 30 amps with UL489A Listing, but is not recommended over 20 amps.
- Terminal Codes 3, 5 and H (Bus Type) with VDE, are supplied with Lock Washers, and Terminal Code M (M6 Threaded Stud) with VDE is supplied with Lock and Flat Washers. These breakers are only VDE Certified when the washers are used.
- Single pole breakers with Terminal Code P (Printed Circuit Board) are available up to 30 amps with VDE Certification and 50 amps with UL489A Listing.
- Single pole only.

A	A	3	B	0	14	450	1	A	1	P
1 Series	2 Actuator	3 Poles	4 Circuit	5 Aux/Alarm Switch	6 Frequency & Delay	7 Current Rating	8 Terminal	9 Actuator Color	10 Mounting/Barriers	11 Agency Approval

1 SERIES
A
2 ACTUATOR¹

A Handle, one per pole
S Mid-Trip Handle, one per pole
T Mid-Trip Handle, one per pole & Alarm Switch

3 POLES

1 One	3 Three	5 Five
2 Two	4 Four	6 Six

4 CIRCUIT

A² Switch Only (No Coil)	D³ Shunt Trip (Current)
B Series Trip (Current)	E³ Shunt Trip (Voltage)
C Series Trip (Voltage)	H^{3,4} Dual Coil with Shunt Trip Voltage Coil

5 AUXILIARY/ALARM SWITCH⁵

0 w/o Aux Switch	4 S.P.D.T., 0.110 Q.C. Term. (Gold Contacts)
2 S.P.D.T., 0.110 Q.C. Term.	
3 S.P.D.T., 0.139 Solder Lug	

6 FREQUENCY & DELAY

03 DC 50/60Hz, Switch Only	30 DC, 50/60Hz Instantaneous
10⁶ DC Instantaneous	31 DC, 50/60Hz Ultra Short
11 DC Ultra Short	32 DC, 50/60Hz Short
12 DC Short	34 DC, 50/60Hz Medium
14 DC Medium	36 DC, 50/60Hz Long
16 DC Long	42⁷ 50/60Hz Short, Hi-Inrush
20⁶ 50/60Hz Instantaneous	44⁷ 50/60Hz Medium, Hi-Inrush
21 50/60Hz Ultra Short	46⁷ 50/60Hz Long, Hi-Inrush
22 50/60Hz Short	52⁷ DC, Short, Hi-Inrush
24 50/60Hz Medium	54⁷ DC, Medium, Hi-Inrush
26 50/60Hz Long	56⁷ DC, Long, Hi-Inrush

7 CURRENT RATING (AMPERES)

210 0.100	285 0.850	455 5.500	613 13.000
215 0.150	290 0.900	460 6.000	614 14.000
220 0.200	295 0.950	465 6.500	615 15.000
225 0.250	410 1.000	470 7.000	616 16.000
230 0.300	512 1.250	475 7.500	617 17.000
235 0.350	415 1.500	480 8.000	618 18.000
240 0.400	517 1.750	485 8.500	620 20.000
245 0.450	420 2.000	490 9.000	622 22.000
250 0.500	522 2.250	495 9.500	624 24.000
255 0.550	527 2.750	610 10.000	625 25.000
260 0.600	430 3.000	710 10.500	630 30.000
265 0.650	435 3.500	611 11.000	635⁸ 35.000
270 0.700	440 4.000	711 11.500	640⁸ 40.000
275 0.750	445 4.500	612 12.000	645⁸ 45.000
280 0.800	450 5.000	712 12.500	650⁸ 50.000

OR VOLTAGE COIL (NOMINAL RATED VOLTAGE)⁶

A06 6 DC	A32 32 DC	J12 12 AC	J65 65 AC
A12 12 DC	A48 48 DC	J18 18 AC	K20 120 AC
A18 18 DC	A65 65 DC	J24 24 AC	L40 240 AC
A24 24 DC	J06 6 AC	J48 48 AC	

8 TERMINAL⁹

1¹⁰ Push-On 0.250 Tab (Q.C.)	B Screw M5 w/upturned lugs
2 Screw 8-32 w/upturned lugs	C Screw M4 w/upturned lugs
3¹¹ Screw 8-32 (Bus Type)	E¹¹ Screw M4 (Bus Type)
4 Screw 10-32 w/upturned lugs	F Screw M5 w/upturned lugs and 30° bend
5¹¹ Screw 10-32 (Bus Type)	G Screw M5 (Bus Type) and 30° bend
6 Screw 8-32 w/upturned lugs and 30° bend	H Screw M5 (Bus Type)
7 Screw 8-32 (Bus Type) and 30° bend	M¹¹ M6 Threaded Stud Push-In Stud
8 Screw 10-32 w/upturned lugs and 30° bend	R Screw M4 w/upturned lugs and 30° bend
9 Screw 10-32 (Bus Type) and 30° bend	T¹¹ Screw M4 (Bus Type) and 30° bend

9 ACTUATOR COLOR & LEGEND

Actuator Color	I-O	Dual	Legend Color
White	A	1	Black
Black	C	2	White
Red	F	3	White
Green	H	4	White
Blue	K	5	White
Yellow	M	6	Black
Gray	P	7	Black
Orange	R	8	Black

10 MOUNTING/BARRIERS

MOUNTING STYLE	BARRIERS
Threaded Inserts, 2 per pole	
1 6-32 x 0.195 inches	no
A 6-32 X 0.195 inches	yes
2 ISO M3 x 5mm	no
B ISO M3 x 5mm	yes
Front panel Snap-In, 0.75" wide bezel	
5 without Handleguard	no
6 without Handleguard	yes
Front panel Snap-In, 0.96" wide bezel	
7 without Handleguard on 1-pole units; .105 " bezel overhang/ side on multipole units	no
8 without Handleguard on 1-pole units; .105 " bezel overhang/side on multipole units	yes

11 AGENCY APPROVAL

P TUV Certified, UL Recognized & CSA Certified
Q UL Rec. STD 1077, UL Rec. 1500 (ignition protected), & CSA Certified

Notes:

- Actuator Code:
A: Handle tie pin spacer(s) and retainers provided unassembled with multi-pole units.
S: Handle moves to mid-position only upon electrical trip of the breaker. Available with circuit codes B, C, D, E, and H.
T: Handle moves to mid-position and alarm switch activates only upon electrical trip of the breaker. Available with circuit codes B & C.
- Switch Only circuits, rated up to 50 amps and 6 poles, and only available when tied to a protected pole (Circuit Code B, C, D or H.). For .01 to 30 amps, select Current Code 630. For 35 - 50 amps, select Current Code 650.
- Available with terminal Codes 1, 2 and 3. Current Rating limited to 30 amps maximum.
- Consult factory for available Dual Coil options, as special catalog number is required. With Shunt construction, Dual Coils will trip instantaneously on line voltage. Dual coils require 30VA minimum power to trip and are rated for intermittent duty only.
- On multi-pole breakers, one auxiliary switch is supplied, mounted in the extreme right pole.
- Separate pole type voltage coils not rated for continuous duty. Available only with delay codes 10, 20 & 30.
- Available with Circuit Codes B & D only and up to 30 amps.
- Available up to two poles with AC or DC delays.
- Screw Terminals are recommended on ratings greater than 20 amps. Ratings over 30 amps are only available with Terminal Codes 5, 9, G and H.
- Terminal Code 1: TUV Certification up to 30 amps, but not recommended over 20 amps.
- Terminal Codes 3, 5, 7, 9, E, G and H (Bus Type) are supplied with Lock Washers. These breakers are ONLY TUV Certified when the washers are used. Terminal Code M (M6 Threaded Stud) with TUV is supplied with lock and flat washers.

A	F	1	B	0	24	630	2	3	1	D
1 Series	2 Actuator	3 Poles	4 Circuit	5 Aux/Alarm Switch	6 Frequency & Delay	7 Current Rating	8 Terminal	9 Actuator Color	10 Mounting/Barriers	11 Agency Approval

1 SERIES

A

2 ACTUATOR ¹

Two Color Visi-Rocker

- C** Indicate ON, vertical legend
- D** Indicate ON, horizontal legend
- E** Indicate ON, no legend
- F** Indicate OFF, vertical legend
- G** Indicate OFF, horizontal legend
- H** Indicate OFF, no legend

Push-To-Reset, Visi-Rocker

- N** Indicate OFF, vertical legend
- O** Indicate OFF, horizontal legend
- P** Indicate OFF, no legend

Single color

- J** Vertical legend
- K** Horizontal legend
- L** No legend

Push-To-Reset, Single color

- R** Vertical legend
- U** Horizontal legend

ROCKER STYLE DESCRIPTIONS		
	INDICATE "ON"	INDICATE "OFF"
VERTICAL STYLE	CODE "C", "N"	CODE "F", "J", "N"
	CODE "D", "O"	CODE "G", "K", "O"
HORIZONTAL STYLE	CODE "H", "R"	CODE "J", "L", "R"
	CODE "K", "U"	CODE "L", "U"

3 POLES ²

1 One **2** Two **3** Three

4 CIRCUIT

- A** ³ Switch Only (No Coil)
- B** Series Trip (Current)
- C** Series Trip (Voltage)
- D** ⁴ Shunt Trip (Current)
- E** ⁴ Shunt Trip (Voltage)
- F** ⁴ Relay Trip (Current)
- G** ⁴ Relay Trip (Voltage)
- H** ^{4, 5} Dual Coil with Shunt Trip Voltage Coil
- K** ^{4, 5} Dual Coil with Relay Trip Voltage Coil

5 AUXILIARY/ALARM SWITCH ^{6, 7}

- 0** w/o Aux Switch
- 1** S.P.D.T., 0.093 Q.C. Term.
- 2** S.P.D.T., 0.110 Q.C. Term.
- 3** S.P.D.T., 0.139 Solder Lug
- 4** S.P.D.T., 0.110 Q.C. Term. (Gold Contacts)
- 5** S.P.S.T., 0.093 Q.C. Term. (Gold Contacts)
- 6** S.P.S.T., 0.139 Solder Lug
- 7** S.P.S.T., 0.110 Q.C. Term. (Gold Contacts)
- 8** S.P.S.T., 0.187 Q.C. Term.
- 9** S.P.D.T., 0.187 Q.C. Term.

6 FREQUENCY & DELAY

- 03** DC 50/60Hz, Switch Only
- 10** ⁸ DC Instantaneous
- 11** DC Ultra Short
- 12** DC Short
- 14** DC Medium
- 16** DC Long
- 20** ⁸ 50/60Hz Instantaneous
- 21** 50/60Hz Ultra Short
- 22** 50/60Hz Short
- 24** 50/60Hz Medium
- 26** 50/60Hz Long
- 30** DC, 50/60Hz Instantaneous
- 31** DC, 50/60Hz Ultra Short
- 32** DC, 50/60Hz Short
- 34** DC, 50/60Hz Medium
- 42** ⁹ 50/60Hz Short, Hi-Inrush
- 44** ⁹ 50/60Hz Medium, Hi-Inrush
- 46** ⁹ 50/60Hz Long, Hi-Inrush
- 52** ⁹ DC, Short, Hi-Inrush
- 54** ⁹ DC, Medium, Hi-Inrush
- 56** DC, Long, Hi-Inrush

Notes:

- 1 Push-To-Reset actuators have OFF portion of rocker shrouded.
- 2 Multi-pole breakers have all breakers identical except when specifying Aux. switch and/or mixed poles, and have one rocker per breaker.
- 3 Switch Only circuits, rated up to 50 amps & 6 poles, are available with VDE Certification when tied to a protected pole (Circuit Code B, C, D or H). For .02 to 30 amps, select Current Code 630. For 35 - 50 amps, select Current Code 650.
- 4 Available with terminal Codes 1, 2 and 3. Current Rating limited to 30 amps maximum.
- 5 Consult factory for Dual Coil options, as special catalog number is required. With Shunt construction, Dual Coils will trip instantaneously on line voltage. Dual coils require 30VA minimum power to trip and are rated for intermittent duty only.
- 6 Auxiliary Switch breakers with Series Trip & Switch Only circuits: ≤ 30A, are supplied with standard half shells. 30-50A are supplied with extended boat (B-Style) half shells.
- 7 On multi-pole breakers, one aux. switch is supplied, mounted in the extreme right pole, per figure A, & is supplied with boat (B-Style) half shells.
- 8 Separate pole type voltage coils not rated for continuous duty. Available only with delay codes 10 and 20.
- 9 Available with Circuit Codes B & D only. VDE Certified to 30 amps. UL Recognized and CSA Certified to 50 amps.
- 10 Series Trip current ratings: VDE Certification available with single pole breakers with DC Delay only. UL Recognition & CSA Certification available in one and two pole breakers.
- 11 Screw Terminals are recommended on ratings greater than 20 amps. Ratings over 30 amps are only available with Terminal Codes 5, 9, G, H, M and Q.
- 12 Terminal Code 1: VDE Certification up to 25 amps and UL Recognition and CSA Certification up to 30 amps, but not recommended over 20 amps.
- 13 Terminal Codes 3, 5 E & H (Bus Type) with VDE, are supplied with Lock Washers; Terminal Code M (M6 Threaded Stud) with VDE is supplied with Lock and Flat Washers. These breakers are only VDE Certified when the washers are used.
- 14 VDE Cert. available up to 12 amps. UL Rec. & CSA Cert. available up to 30 amps.
- 15 Single pole breakers with Terminal Code P (Printed Circuit Board) are available up to 30 amps with VDE Certification and 50 amps with UL Recognition and CSA Certification, with Circuit Codes A, B and C. Two pole breakers with Terminal Code P (Printed Circuit Board) are available up to 40 amps with UL Recognition and CSA Certification with Circuit Codes A, B and C.
- 16 Terminal Code S used on voltage coil circuit constructions only.
- 17 Color shown is visi and legend with remainder of rocker black.
- 18 Legend on Push-to-reset bezel/shroud is white when single color rocker is ordered. Dual = ON-OFF-I/O legend with actuator codes C - G, and J, K, N, O, R, & U. None = no legend with actuator codes H, L, P, V. Rockerguard available with actuator codes C - L. Push-to-reset available with actuator codes N, O, P, R, U, V.

7 CURRENT RATING (AMPERES)

020	0.020	225	0.250	420	2.000	611	11.000
025	0.025	230	0.300	522	2.250	711	11.500
030	0.030	235	0.350	527	2.750	712	12.000
035	0.035	240	0.400	430	3.000	712	12.500
040	0.040	245	0.450	435	3.500	613	13.000
045	0.045	250	0.500	440	4.000	614	14.000
050	0.050	255	0.550	445	4.500	615	15.000
055	0.055	260	0.600	450	5.000	616	16.000
060	0.060	265	0.650	455	5.500	617	17.000
065	0.065	270	0.700	460	6.000	618	18.000
070	0.070	275	0.750	465	6.500	620	20.000
075	0.075	280	0.800	470	7.000	622	22.000
080	0.080	285	0.850	475	7.500	624	24.000
085	0.085	290	0.900	480	8.000	625	25.000
090	0.090	295	0.950	485	8.500	630	30.000
095	0.095	410	1.000	490	9.000	635 ¹⁰	35.000
210	0.100	512	1.250	495	9.500	640 ¹⁰	40.000
215	0.150	415	1.500	610	10.000	645 ¹⁰	45.000
220	0.200	517	1.750	710	10.500	650 ¹⁰	50.000

OR VOLTAGE COIL (NOMINAL RATED VOLTAGE)

A06	6 DC	A32	32 DC	J12	12 AC	J65	65 AC
A12	12 DC	A48	48 DC	J18	18 AC	K20	120 AC
A18	18 DC	A65	65 DC	J24	24 AC	L40	240 AC
A24	24 DC	J06	6 AC	J48	48 AC		

8 TERMINAL ¹¹

- 1** ¹² Push-On 0.250 Tab (Q.C.)
- 2** Screw 8-32 w/upturned lugs
- 3** ¹³ Screw 8-32 (Bus Type)
- 4** Screw 10-32 w/upturned lugs
- 5** ¹³ Screw 10-32 (Bus Type)
- 6** Screw 8-32 w/upturned lugs and 30° bend
- 7** Screw 8-32 (Bus Type) and 30° bend
- 8** Screw 10-32 w/upturned lugs and 30° bend
- 9** Screw 10-32 (Bus Type) and 30° bend
- B** Screw M5 w/upturned lugs
- C** Screw M4 w/upturned lugs
- E** ¹³ Screw M4 (Bus Type)
- F** Screw M5 w/upturned lugs and 30° bend
- G** Screw M5 (Bus Type) and 30° bend
- H** Screw M5 (Bus Type)
- L** ¹⁴ 0.250 Q.C./ Solder Lug
- M** ¹³ M6 Threaded Studs
- P** ¹⁵ Printed Circuit Board Terminals
- Q** Push-In Stud
- R** Screw M4 w/upturned lugs and 30° bend
- S** ¹⁶ Push-On 0.110 Tab (Q.C.)
- T** Screw M4 (Bus Type) and 30° bend

9 ACTUATOR COLOR & LEGEND

Actuator or Visi-Color ¹⁷	Marking:			Marking Color:	
	I-O	ON-OFF	Dual/None	Single Color	Visi-Rocker
White	A	B	1	Black	White
Black	C	D	2	White	n/a
Red	F	G	3	White	Red
Green	H	J	4	White	Green
Blue	K	L	5	White	Blue
Yellow	M	N	6	Black	Yellow
Gray	P	Q	7	Black	Gray
Orange	R	S	8	Black	Orange

10 MOUNTING/BARRIERS ¹⁸

STANDARD ROCKER BEZEL, Threaded Insert, 2 per pole		BARRIERS
1	6-32 x 0.195 inches	no
A	6-32 X 0.195 inches (multi-pole units only)	yes
2	ISO M3 x 5mm	no
B	ISO M3 x 5mm (multi-pole units only)	yes
ROCKERGARD & PUSH-TO-RESET BEZEL, Threaded Insert, 2 per pole		
3	6-32 x 0.195 inches	no
C	6-32 x 0.195 inches (multi-pole units only)	yes
4	ISO M3 x 5mm	no
D	ISO M3 x 5mm (multi-pole units only)	yes
FRONT PANEL SNAP-IN BRACKET, 0.744" wide bezel		
8	without Rockerguard (multi-pole units only)	no
H	with Rockerguard (multi-pole units only)	yes
FRONT PANEL SNAP-IN BRACKET, 0.96" wide bezel		
9	without Rockerguard (single pole units only)	no
J	with Rockerguard (single pole units only)	yes

11 AGENCY APPROVAL

- C** UL Recognized & CSA Certified
- D** VDE Certified, UL Recognized & CSA Certified
- E** TUV Certified, UL Recognized & CSA Certified
- I** UL Rec. STD 1077, UL Rec. 1500 (ignition protected), & CSA Certified

A	F	1	B	0	14	450	1	3	1	M	T
1 Series	2 Actuator	3 Poles	4 Circuit	5 Aux/Alarm Switch	6 Frequency & Delay	7 Current Rating	8 Terminal	9 Actuator Color	10 Mounting/Barriers	11 Max. Appl. Rating	12 Agency Approval

1 SERIES
A
2 ACTUATOR ¹
Two Color Visi-Rocker

- C** Indicate ON, vertical legend
D Indicate ON, horizontal legend
F Indicate OFF, vertical legend
G Indicate OFF, horizontal legend

Single color

- J** Vertical legend
K Horizontal legend

Push-To-Reset, Single color

- R** Vertical legend
U Horizontal legend

ROCKER STYLE DESCRIPTIONS					
VERTICAL STYLE	INDICATE "ON"		INDICATE "OFF"		SINGLE COLOR
	CODE "C"	CODE "D"	CODE "F"	CODE "G"	
HORIZONTAL STYLE	INDICATE "ON"		INDICATE "OFF"		SINGLE COLOR
	CODE "J"	CODE "K"	CODE "R"	CODE "U"	

3 POLES²

- 1** One **2** Two **3** Three

4 CIRCUIT

- B** Series Trip (Current)

5 AUXILIARY/ALARM SWITCH

- | | |
|---|-------------------------------------|
| 0 w/o Aux Switch | 7 S.P.S.T., 0.110 Q.C. |
| 1³ S.P.D.T., 0.093 Q.C. Term. | 8 S.P.S.T., 0.187 Q.C. Term. |
| 2³ S.P.D.T., 0.110 Q.C. Term. | 9 S.P.D.T., 0.187 Q.C. Term. |
| 3³ S.P.D.T., 0.139 Solder Lug | |

6 FREQUENCY & DELAY

- | | |
|--------------------------|---|
| 11 DC Ultra Short | 52⁴ DC, Short, Hi-Inrush |
| 12 DC Short | 54⁴ DC, Medium, Hi-Inrush |
| 14 DC Medium | 56⁴ DC, Long, Hi-Inrush |
| 16 DC Long | |

7 CURRENT RATING (AMPERES)

210 0.100	415 1.500	710 10.500
215 0.150	517 1.750	611 11.000
220 0.200	420 2.000	711 11.500
225 0.250	522 2.250	612 12.000
230 0.300	527 2.750	712 12.500
235 0.350	430 3.000	613 13.000
240 0.400	435 3.500	614 14.000
245 0.450	440 4.000	615 15.000
250 0.500	445 4.500	616 16.000
255 0.550	450 5.000	617 17.000
260 0.600	455 5.500	618 18.000
265 0.650	460 6.000	620 20.000
270 0.700	465 6.500	622 22.000
275 0.750	470 7.000	624 24.000
280 0.800	475 7.500	625 25.000
285 0.850	480 8.000	630 30.000
290 0.900	485 8.500	635⁵ 35.000
295 0.950	490 9.000	640⁵ 40.000
410 1.000	495 9.500	645⁵ 45.000
512 1.250	610 10.000	650⁵ 50.000

8 TERMINAL⁶

- 1⁷** Push-On 0.250 Tab (Q.C.)
2 Screw 8-32 w/upturned lugs
3⁸ Screw 8-32 (Bus Type)
4 Screw 10-32 w/upturned lugs
5⁸ Screw 10-32 (Bus Type)
6 Screw 8-32 w/upturned lugs and 30° bend
7 Screw 8-32 (Bus Type) and 30° bend
8 Screw 10-32 w/upturned lugs and 30° bend

- 9** Screw 10-32 (Bus Type) and 30° bend
B Screw M5 w/upturned lugs
F Screw M5 w/upturned lugs and 30° bend
G Screw M5 (Bus Type) and 30° bend
H Screw M5 (Bus Type)
M⁸ M6 Threaded Stud
P⁹ Printed Circuit Board Terminals
Q Push-In Stud

9 ACTUATOR COLOR & LEGEND

Actuator or Visi-Color		Marking:		Marking Color:	
Color:	ON-OFF	Single Color	Dual/None	Rocker/Handle	Visi-Rocker
White	B	1		Black	White
Black	D	2		White	n/a
Red	G	3		White	Red
Green	J	4		White	Green
Blue	L	5		White	Blue
Yellow	N	6		Black	Yellow
Gray	Q	7		Black	Gray
Orange	S	8		Black	Orange

10 MOUNTING/BARRIERS

STANDARD ROCKER BEZEL		BARRIERS
Threaded Insert, 2 per pole		
1 6-32 x 0.195 inches		no
A 6-32 x 0.195 inches (multi-pole units only)		yes
2 ISO M3 x 5mm		no
B ISO M3 x 5mm (multi-pole units only)		yes
ROCKERGUARD & PUSH-TO-RESET BEZEL		
Threaded Insert, 2 per pole		
3 6-32 x 0.195 inches		no
C 6-32 x 0.195 inches (multi-pole units only)		yes
4 ISO M3 x 5mm		no
D ISO M3 x 5mm (multi-pole units only)		yes
FRONT PANEL SNAP-IN BRACKET, 0.744" [18.90mm] wide bezel		
8 without Rockerguard (multi-pole units only)		no
H with Rockerguard (multi-pole units only)		yes
FRONT PANEL SNAP-IN BRACKET, 0.96" [24.48mm] wide bezel		
9 without Rockerguard (single pole units only)		no
J with Rockerguard (single pole units only)		yes

11 MAXIMUM APPLICATION RATING

- M** 80 DC

12 AGENCY APPROVAL

- T** UL489A LISTED
K UL489A LISTED, VDE CERTIFIED












Notes:








- Push-To-Reset actuators have OFF portion of rocker shrouded.
- Multi-pole breakers have all breakers identical except when specifying Aux. switch and/or mixed poles, and have one rocker per breaker.
- Auxiliary Switch breakers with Series Trip & Switch Only circuits: ≤ 30A, are supplied with standard half shells. 30-50A are supplied with extended boat (B-Style) half shells.
- VDE Certified to 30 amps. UL489A Listed to 50 amps.
- VDE Certification available with single pole breakers only. UL489A Listing available with one and two pole breakers.
- Screw Terminals are recommended on ratings greater than 20 amps. Ratings over 30 amps are only available with Terminal Codes 5, 9, G, H, M and Q.
- Terminal Code 1 (Push-On) available up to 25 amps with VDE Certification and 30 amps with UL489A Listing, but is not recommended over 20 amps.
- Terminal Codes 3, 5 and H (Bus Type) with VDE, are supplied with Lock Washers, and Terminal Code M (M6 Threaded Stud) with VDE is supplied with Lock and Flat Washers. These breakers are only VDE Certified when the washers are used.
- Single pole breakers with Terminal Code P (Printed Circuit Board) are available up to 30 amps with VDE Certification and 50 amps with UL489A Listing.


2 TERMINALS	CIRCUIT BREAKER PROFILE	CIRCUIT SCHEMATIC		CIRCUIT SCHEMATIC		CIRCUIT CODE	AUX SWITCH CODE
		ANSI		ANSI			
		SWITCH ONLY (NO COIL)		SERIES TRIP			
			A	0		BC	0
5 TERMINALS		SWITCH ONLY (NO COIL) WITH AUXILIARY SWITCH		SERIES TRIP WITH (3) AUXILIARY/ALARM SWITCH		A	1 2 3 4
					BC		
3 TERMINALS		SHUNT TRIP		DUAL COIL; SERIES TRIP CURRENT COIL, SHUNT TRIP VOLTAGE COIL		DE <th rowspan="2">0</th>	0
					H		
4 TERMINALS		RELAY TRIP		DUAL COIL; SERIES TRIP CURRENT COIL, RELAY TRIP VOLTAGE COIL		FG <th rowspan="2">0</th>	0
					K		

Notes:

- 1 All dimensions are in inches [millimeters].
- 2 Tolerance ± 0.015 [.38] unless otherwise specified.
- 3 Alarm Switch available with .110 x .020 Q.C. & Solder Lug Terminals Only.

HANDLE POSITION VS. AUX /ALARM SWITCH MODE				
CIRCUIT BREAKER MODE	STANDARD C/B		MID TRIP C/B	
	HANDLE POSITION	AUX. SWITCH MODE	HANDLE POSITION	ALARM SWITCH MODE
OFF				
ON				
ELECTRICAL TRIP				

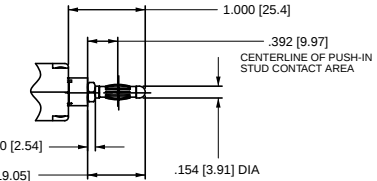TERMINAL DIMENSIONAL DETAIL & RATING						
						
TAB (Q.C.) ≤ 30 AMP	UPTURN LUG #8-32 ≤ 30 AMP #10-32 ≤ 30 AMP M5 ≤ 30 AMP M4 ≤ 30 AMP	BUS #8-32 ≤ 30 AMP #10-32 ≤ 50 AMP	QC SOLDER LUG ≤ 30 AMP	.110 QC VOLTAGE COILS ONLY	M5 STUD ≤ 50 AMP	PUSH-IN STUD ≤ 50 AMP






AUXILIARY/ALARM SWITCH TERMINAL DETAIL		
		
TAB (Q.C.)	TAB (Q.C.)	SOLDER TYPE

TABLE A TIGHTENING TORQUE SPECIFICATIONS	
THREAD SIZE	TORQUE
#6-32 & M3 MOUNTING HARDWARE	7-9 IN-LBS [0.8- 1.0 NM]
#8-32 & M4 THREAD TERMINAL SCREW	12-15 IN-LBS [1.4-1.7 NM]
#10-32 & M5 THREAD TERMINAL SCREW	15-20 IN-LB [1.7-2.3 NM]

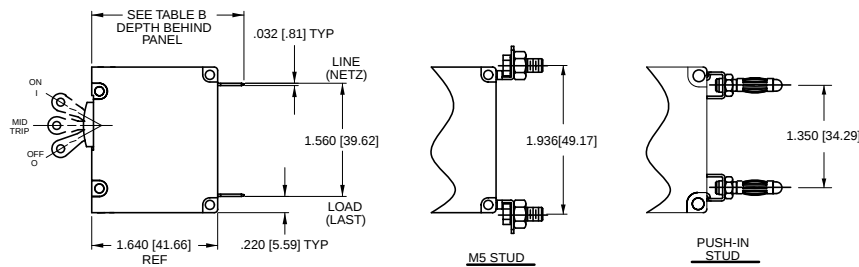




TABLE B		
TERMINAL DESCRIPTION		DEPTH BEHIND PANEL
MAIN	TAB (Q.C.)	2.000 [50.80]
	SCREW TYPE	2.032 [51.60]
SHUNT, RELAY & DUAL COIL	TAB (Q.C.)	2.207 [56.10]
	SCREW #8-32 W/ UPTURNED LUGS	2.364 [60.05]
AUX. SWITCH*	.093 TAB (Q.C.)	2.095 [53.20]
	.110 TAB (Q.C.)	2.189 [55.60]
	SOLDER TYPE	1.970 [50.00]

* AVAILABLE ON SERIES TRIP AND SWITCH ONLY CIRCUITS. WHEN CALLED FOR ON MULTI-POLE UNITS, ONLY ONE AUX. SWITCH IS NORMALLY SUPPLIED, AS SHOWN IN MULTI-POLE IDENTIFICATION SCHEME. SEE PAGE

Notes:


- All dimensions are in inches [millimeters].
- Tolerance ±.015 [.38] unless otherwise specified.

**1-POLE
(AA1)**

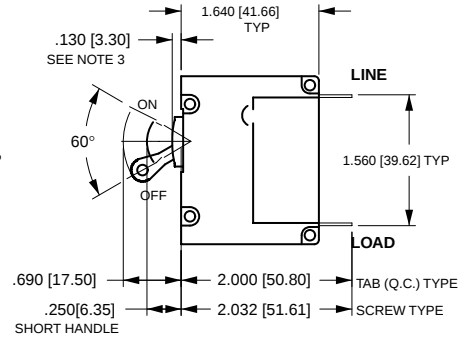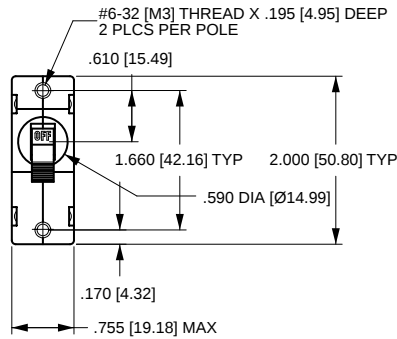


TAB (Q.C.) TYPE TERMINALS IN SERIES TRIP CIRCUIT CONFIGURATION SHOWN. FOR OTHER CONFIGURATIONS SEE CIRCUIT AND TERMINAL DIAGRAMS.


**2-POLE
(AA2)**

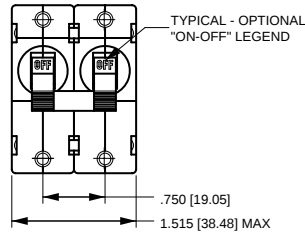


**2-POLE
(AB2)**




**3-POLE
(AA3)**

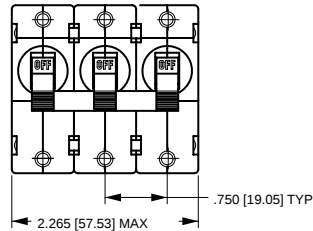



**3-POLE
(AB3)**



**4-POLE
(AA4)**

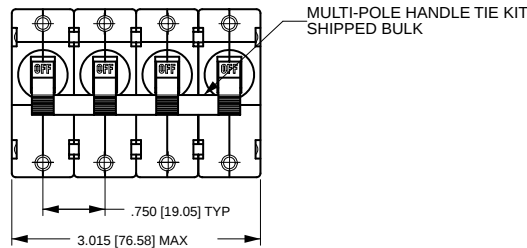

**4-POLE
(AB4)**

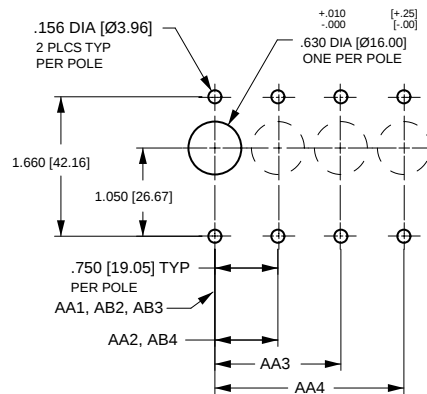


PANEL CUTOUT DETAIL

TOLERANCES ±.005 [±.12]
UNLESS OTHERWISE SPECIFIED

Notes:




- 1 All dimensions are in inches [millimeters].
- 2 Tolerance ±.010 [.25] unless otherwise specified.
- 3 For agency code P = .150 [3.81].

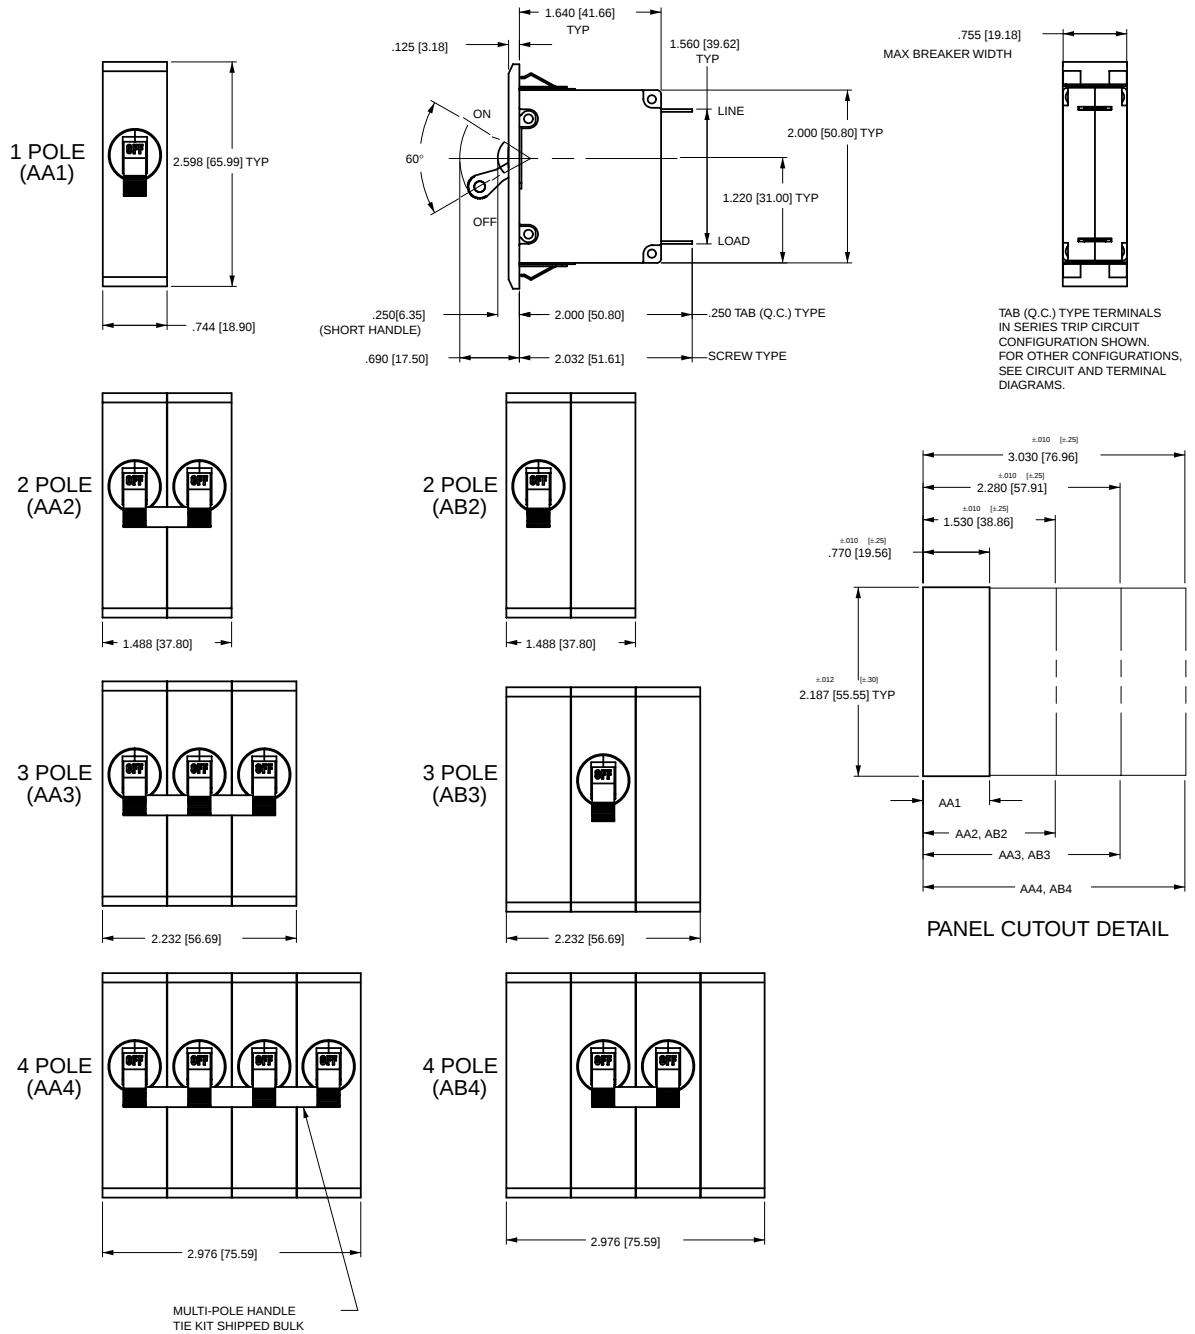

Notes:


- 1 All dimensions are in inches [millimeters].
- 2 Recommended panel thickness: .040 [1.02] to .100 [2.54].
- 3 Tolerance ± 0.015 [.38] unless otherwise specified.

**1 POLE
(AA1)**

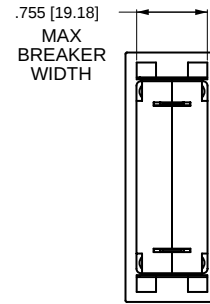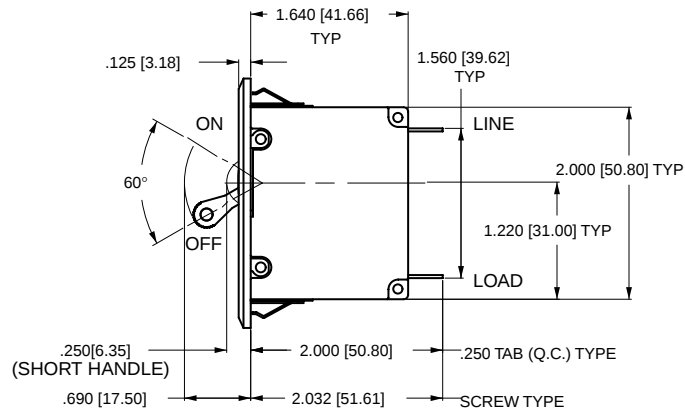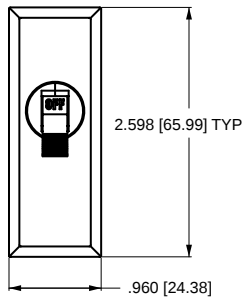


TAB (Q.C.) TYPE TERMINALS
IN SERIES TRIP CIRCUIT
CONFIGURATION SHOWN.
FOR OTHER CONFIGURATIONS,
SEE CIRCUIT AND TERMINAL
DIAGRAMS.


**2 POLE
(AA2)**




**2 POLE
(AB2)**




**3 POLE
(AA3)**




**3 POLE
(AB3)**




**4 POLE
(AA4)**

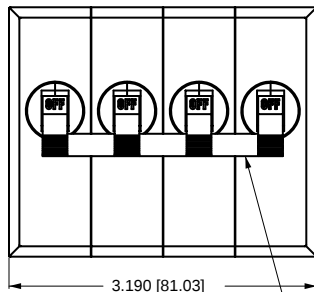

**4 POLE
(AB4)**

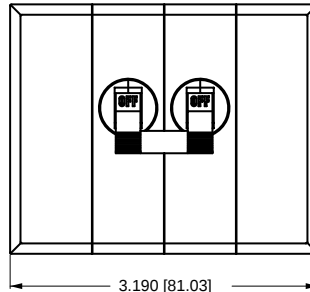

MULTI-POLE HANDLE TIE KIT
SHIPPED BULK

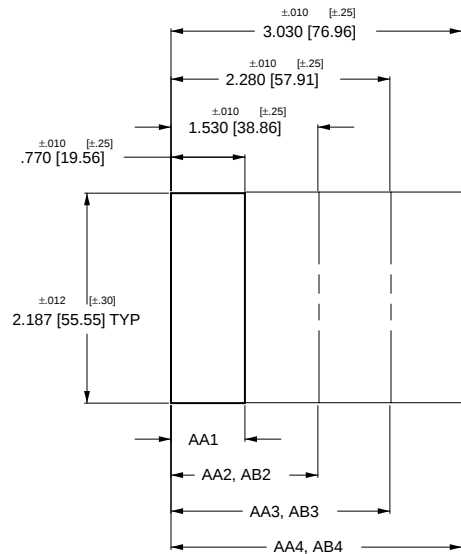

PANEL CUTOUT DETAIL

Notes:

- 1 All dimensions are in inches [millimeters].
- 2 Recommended panel thickness: .040 [1.02] to .100 [2.54].
- 3 Tolerance ± 0.015 [.38] unless otherwise specified.

CIRCUIT BREAKER PROFILE		CIRCUIT SCHEMATIC		CIRCUIT CODE	AUX SWITCH CODE	CIRCUIT SCHEMATIC		CIRCUIT CODE	AUX SWITCH CODE
2 TERMINALS		ANSI	IEC			ANSI	IEC		
		SWITCH ONLY (NO COIL)				SERIES TRIP			
				A	0			BC	0
5 TERMINALS		SWITCH ONLY (NO COIL) (4) WITH AUXILIARY SWITCH		A	1 2 3 4	SERIES TRIP WITH (4) AUXILIARY SWITCH		BC	1 2 3 4
3 TERMINALS		SHUNT TRIP		DE	0	DUAL COIL; SERIES TRIP CURRENT COIL, SHUNT TRIP VOLTAGE COIL		H	0
4 TERMINALS		RELAY TRIP		FG	0	DUAL COIL; SERIES TRIP CURRENT COIL, RELAY TRIP VOLTAGE COIL		K	0

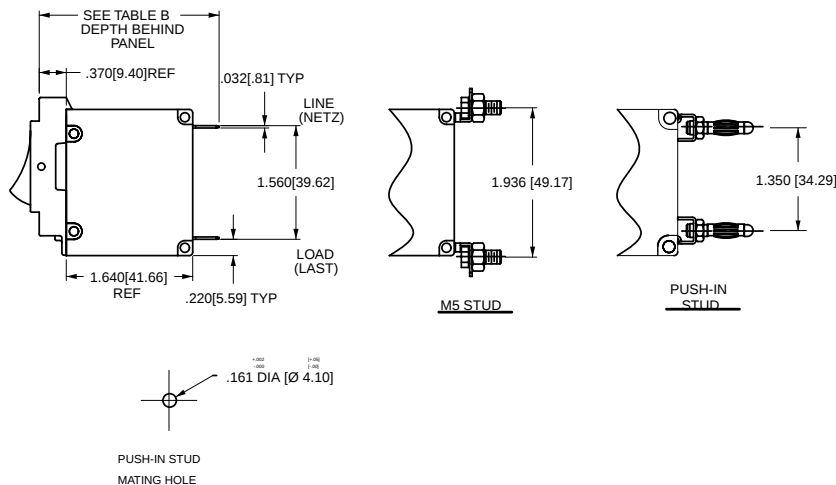


TABLE B		
TERMINAL DESCRIPTION		DEPTH BEHIND PANEL
MAIN	TAB (Q.C.)	2.370 [60.20]
	SCREW TYPE	2.402 [61.01]
SHUNT, RELAY & DUAL COIL	TAB (Q.C.)	2.577 [65.46]
	SCREW #8-32 W/UPTURNED LUGS	2.734 [69.44]
AUX. SWITCH*	.093 TAB (Q.C.)	2.465 [62.61]
	.110 TAB (Q.C.)	2.559 [65.00]
	SOLDER TYPE	2.340 [59.44]

* AVAILABLE ON SERIES TRIP AND SWITCH ONLY CIRCUITS. WHEN CALLED FOR ON MULTI-POLE UNITS, ONLY ONE AUX. SWITCH IS NORMALLY SUPPLIED, AS VIEWED IN MULTI-POLE IDENTIFICATION SCHEME.

Notes:

- 1 All dimensions are in inches [millimeters].
- 2 Tolerance ± 0.015 [.38] unless otherwise specified.
- 3 Schematic shown represents current trip circuit.
- 4 Circuits shown for >30 amps / VDE.



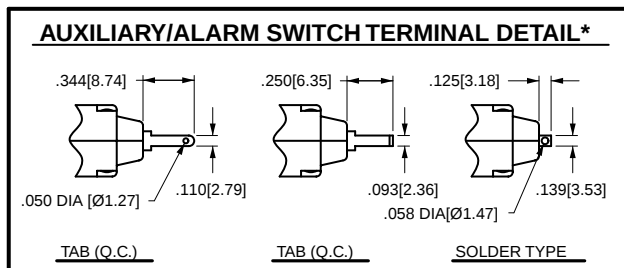


TABLE A TIGHTENING TORQUE SPECIFICATIONS	
THREAD SIZE	TORQUE
#6-32 & M3 MOUNTING HARDWARE	7-9 IN-LBS [0.8-1.0 NM]
#8-32 & M4 THREAD TERMINAL SCREW	12-15 IN-LBS [1.4-1.7 NM]
#10-32 & M5 THREAD TERMINAL SCREW	15-20 IN-LBS [1.7-2.3 NM]

Notes:


- All dimensions are in inches [millimeters].
- Tolerance ±.015 [.38] unless otherwise specified.

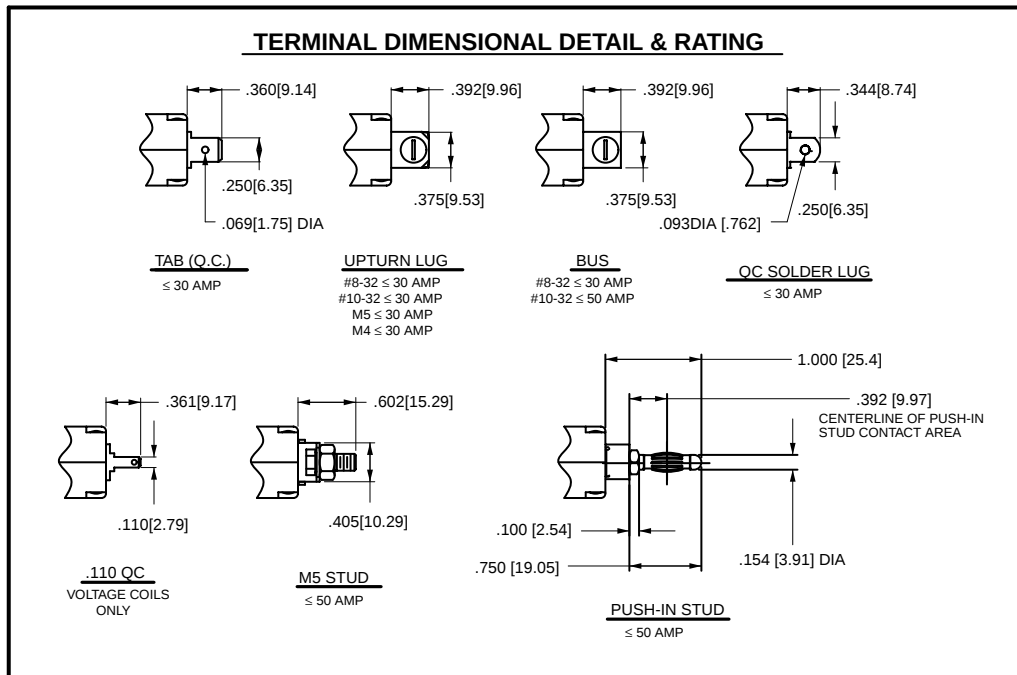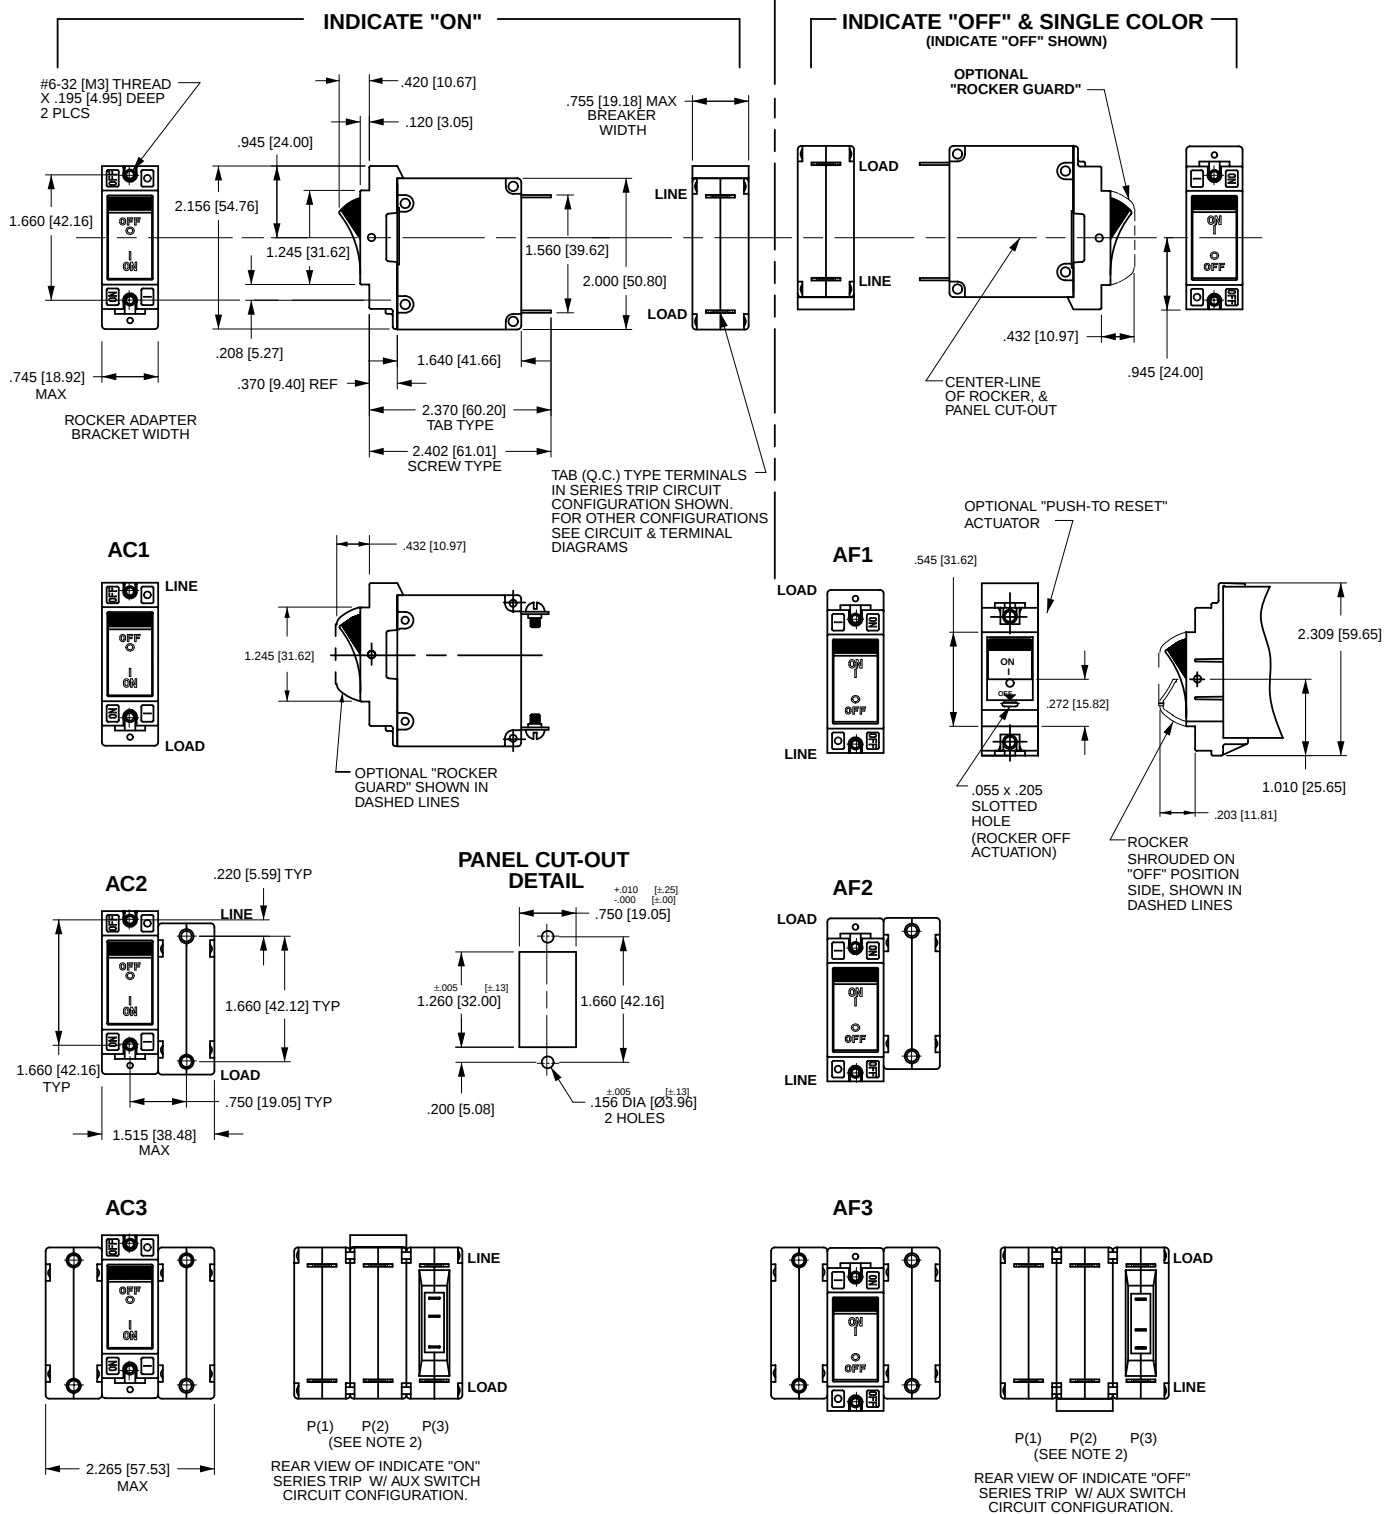


Notes:

- 1 Dimensions apply to all variations shown. Notice that circuit breaker line & load terminal orientation on indicate OFF is opposite of indicate ON.
- 2 For pole orientation with horizontal legend, rotate front view clockwise 90°.
- 3 All dimensions are in inches [millimeters].
- 4 Tolerance ±.010 [.25] unless otherwise specified.

A-SERIES ROCKER

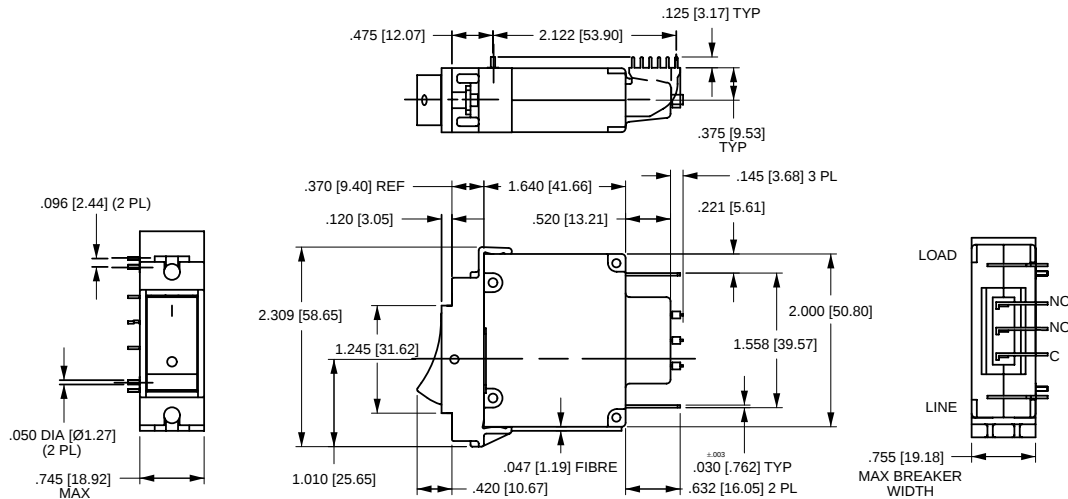

A-SERIES HANDLE

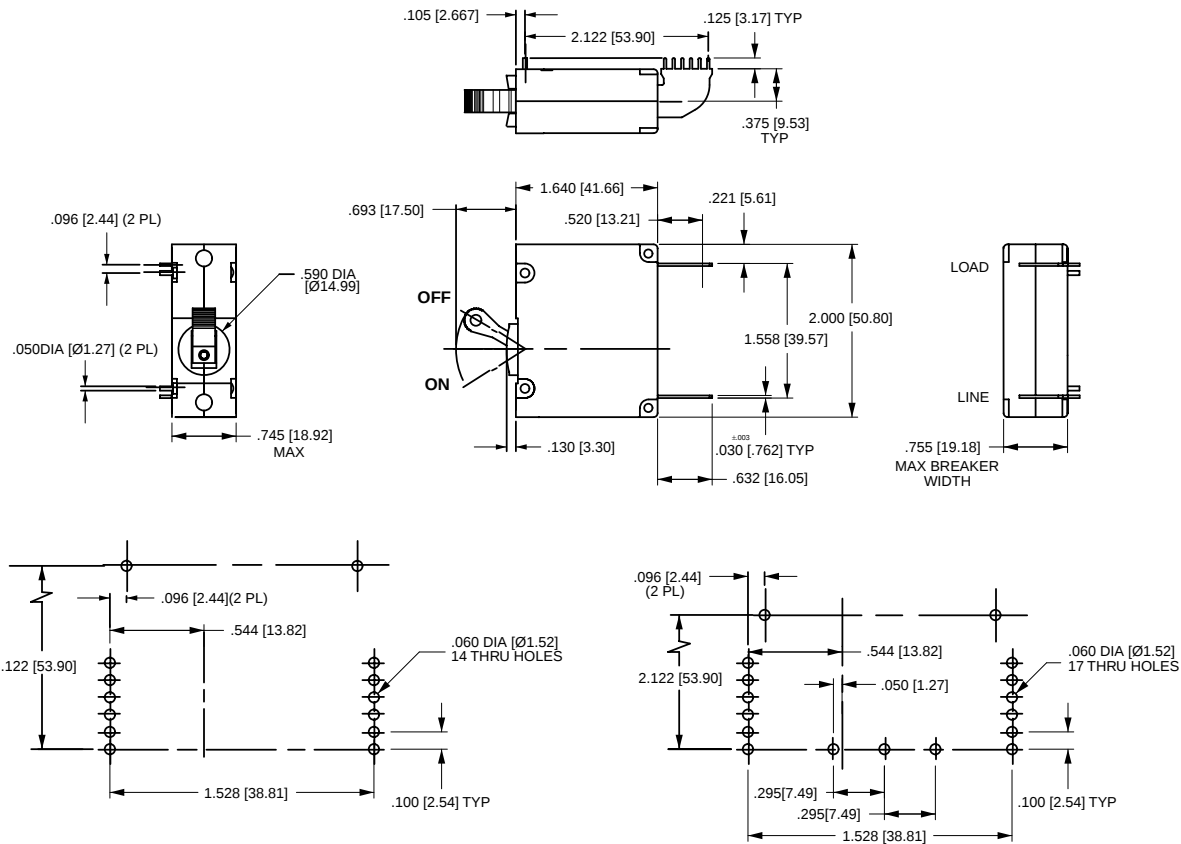

P.C. FOOT PRINT

P.C. FOOT PRINT
WITH AUX. SWITCH

Notes:

- 1 Drawing illustrates A-Series with VDE certification.
- 2 All dimensions are in inches [millimeters].
- 3 Tolerance ± 0.10 [.25] unless otherwise specified.